

Campaspe System

January 2019



The Campaspe System only supplies the town of Goornong (it formerly supplied the towns of Axedale and Rochester).

Raw water is supplied from the Campaspe River.

Goulburn-Murray Water manages the raw water supply.

Water Summaries are prepared each month to provide current water resource information.

Our Urban Water Strategy outlines our water supply initiatives to meet our region's residential, business and community water needs for the next 50 years.

Our nine supply systems have independent sources of water and supply constraints.

Please ensure you read the update relevant to your town.

To ensure we are providing information that is relevant and useful, send your suggestions and feedback to our postal address:

37- 45 Bridge Street,
Bendigo 3550 or e-mail to:
communications@coliban.com.au




Available raw water supply

| Carryover last year | Allocation to date | Allocation Trade ² | Spillable water ¹ | Usage to date | Total Available (Megalitres) |
|---------------------|--------------------|-------------------------------|------------------------------|---------------|------------------------------|
| 78 ML | 349 ML | 0 ML | 0 ML | 50 ML | 377 ML |

¹ Water spill and held in the spillable water account. There is a risk of spill of water in excess of our entitlement volume.

² Seasonal allocation water sold during month, year or transferred to a trading account. Includes transfers into and out of this system.

The graph below shows the raw water 12-month supply and demand outlook for the Campaspe System

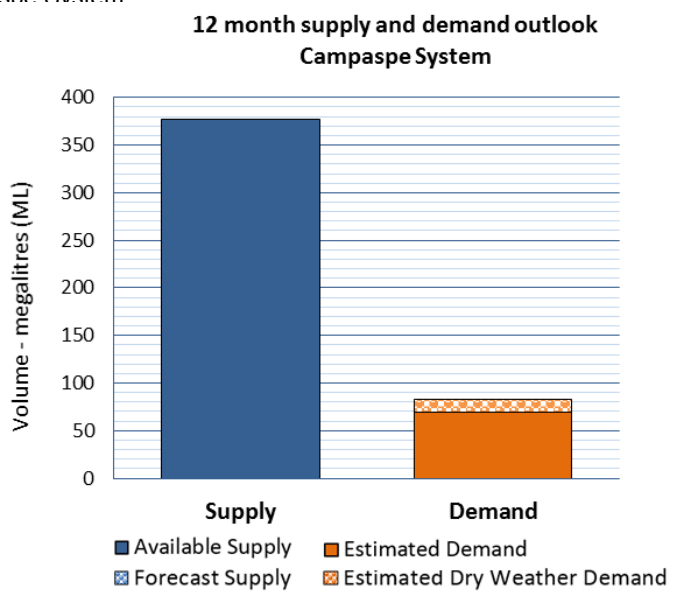

Further system information

> **Bulk entitlement volume**
- 349 ML

> **Allocation volume**
- 100% - 349 ML

> **Allocation trade**
Seasonal allocation against bulk entitlements and water shares can be traded on the water market into and out of this system.
In average years the total allocation is not required to meet demand.

> **Spillable Water Account**
Restrictions apply to the holding of allocation in excess of 100% of the entitlement volume.


The external Resource Manager (Goulburn-Murray Water) may allow this water to be held in a 'spillable water account' until such time as it is either spilt, or credited to an allocation account.

A low risk of spill was declared in the Campaspe System on 10 September 2018.

> **Water restriction outlook**
Permanent Water Saving Rules (PWSR) currently apply.
The restriction levels are based on seasonal allocations and are reviewed monthly.

Demand comparison

The graph below shows 2018-19 cumulative water usage for the Campaspe System compared with the same period last year and estimated demand.

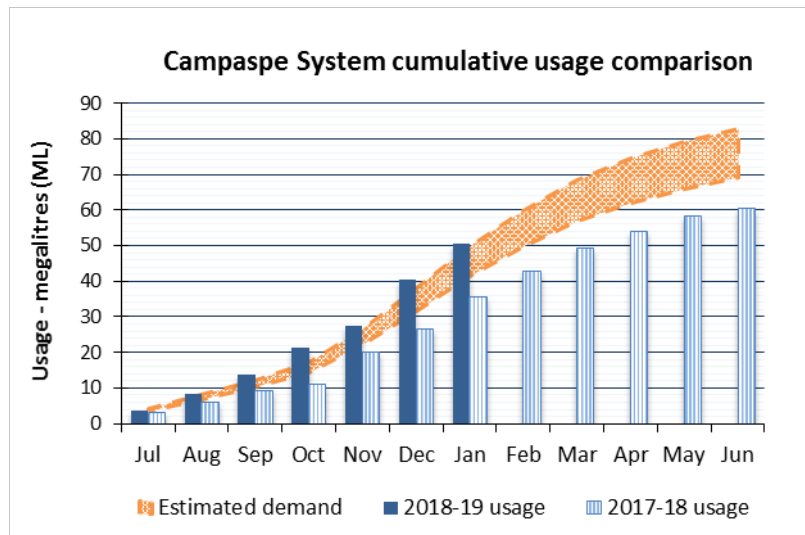

For part of October and November 2017 the raw water demand for Goornong was supplied from our Elmore System.

Monthly usage by town

The graph below show this month's water usage for Goornong compared with the same period last year.

