


Goulburn System

January 2019



NORTH

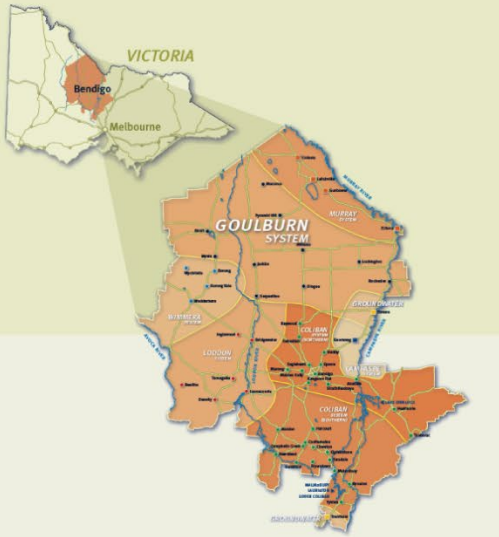

Legend

- Potable Water
- Raw Water
- Non potable Supply

The Goulburn System supplies the towns of Rochester, Pyramid Hill, Boort, Lockington, Mitiamo, Serpentine, Dingee, Jarklin, Mysiya and Macorna.

Raw water is supplied from the Waranga Western Channel. Goulburn-Murray Water manages the raw water supply.

Water Summaries are prepared each month to provide current water resource information.

Our Urban Water Strategy outlines our water supply initiatives to meet our region's residential, business and community water needs for the next 50 years.

Our supply systems have independent sources of water and supply constraints.

Please ensure you read the update relevant to your town.

To ensure we are providing information that is relevant and useful, send your suggestions and feedback to our postal address:

37- 45 Bridge Street,
Bendigo 3550 or e-mail to:
communications@coliban.com.au


Available raw water supply

Carryover last year	Allocation to date	Allocation trade	Spillable water ¹	Usage to date	Total available (Megalitres)
361 ML	2,477 ML	0 ML	0 ML	685 ML	2,153 ML

¹ Water spilt and held in the spillable water account.

² Seasonal Allocation water sold during month, year or transferred to a trading account.

The graph below shows the raw water 12 month supply and demand outlook for the Goulburn System.

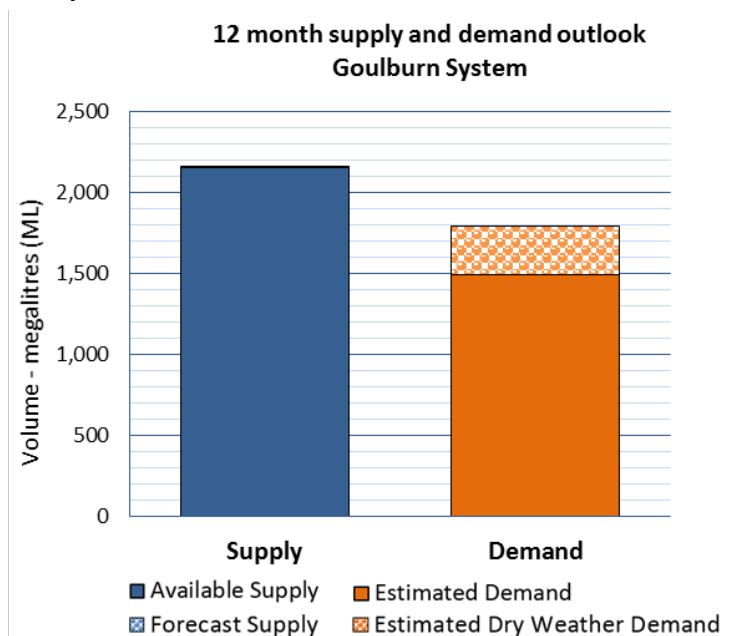

Further system information

> **Bulk entitlement volume**
- 2,420 ML

Our Goulburn System Entitlement has a very high reliability of supply.

> **Water Allowance**
- 60 ML

Our water allowance has the same reliability as High Reliability Water Shares.

> **Allocation volume**
Bulk Entitlement - 100% - 2,420 ML
Water Allowance - 95% - 57 ML


> **Allocation trade**
Seasonal allocations against bulk entitlements and water shares can be traded on the water market into and out of this system. In average years the total allocation is not required to meet demand.

> **Spillable Water Account**
Restrictions apply to the holding of allocation in excess of 100% of the entitlement volume. The external Resource Manager (Goulburn-Murray Water) may allow this water to be held in a 'spillable water account' until such time as it is either spilt, or credited to an allocation account. A low risk of spill was declared in the Goulburn System on 10 September 2018.

> **Water restriction outlook**
Permanent Water Saving Rules (PWSR) currently apply. The restriction levels are based on seasonal allocations and are reviewed monthly.

Demand comparison

The graph below shows 2018-19 cumulative water usage for the Goulburn System compared with the same period last year and estimated demand.

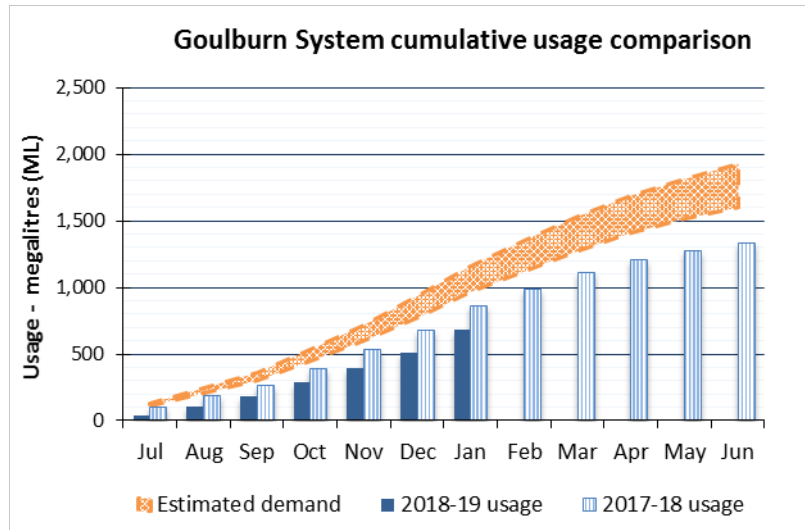

Monthly usage by towns

The graphs below show this month's water usage for the Goulburn System and each town supplied by this system, compared with the same period last year.

