



## Groundwater System: Elmore



The Elmore System only supplies the town of Elmore.

Raw water is supplied from two groundwater bores. Goulburn-Murray Water manages the raw water supply.

Elmore is within the Lower Campaspe Valley Groundwater Management Area, Elmore-Rochester Zone.

Water Summaries are prepared each month to provide current water resource information.

Our Urban Water Strategy outlines our water supply initiatives to meet our region's residential, business and community water needs for the next 50 years.

Our nine supply systems have independent sources of water and supply constraints.

Please ensure you read the update relevant to your town.

To ensure we are providing information that is relevant and useful, send your suggestions and feedback to our postal address:


37- 45 Bridge Street,  
Bendigo 3550 or e-mail to:  
communications@coliban.com.au

## Available raw water supply

Carryover last year <sup>1</sup>	Allocation to date	Allocation trade	Usage to date	Total Available (Megalitres)
71 ML	284 ML	0 ML	137 ML	218 ML

<sup>1</sup> From January 2016 we have included carryover from last year in our available raw water supply. Our groundwater licence allows carryover from the previous year. The maximum carryover is 25% of the entitlement volume.

The graph below shows the raw water 12 month supply and demand outlook for the Elmore System.

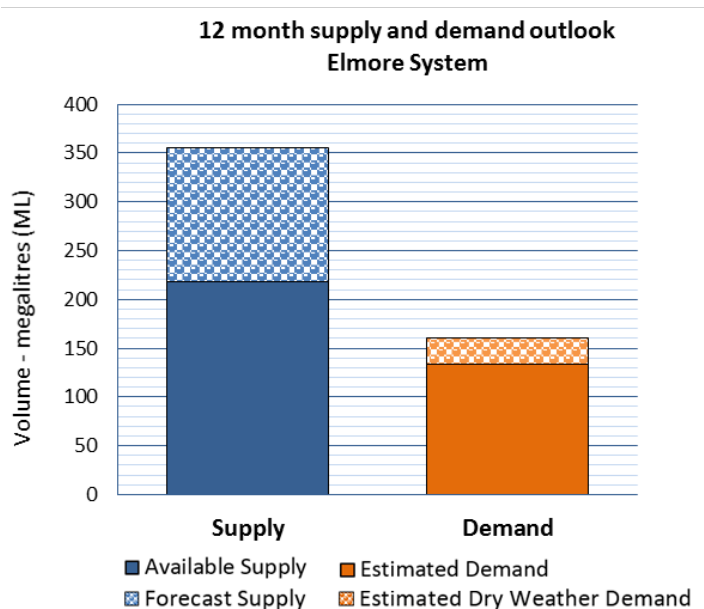

**Further system information**


> **Groundwater licence volume**  
- 284 ML

> **Allocation volume**  
- 100% - 284 ML

> **Water restriction outlook**  
Permanent Water Saving Rules (PWSR) currently apply.  
The restriction levels are based on seasonal allocations and are reviewed monthly.

**Demand comparison**

The graph below shows 2018-19 cumulative water usage for the Elmore System compared with the same period last year and estimated demand.

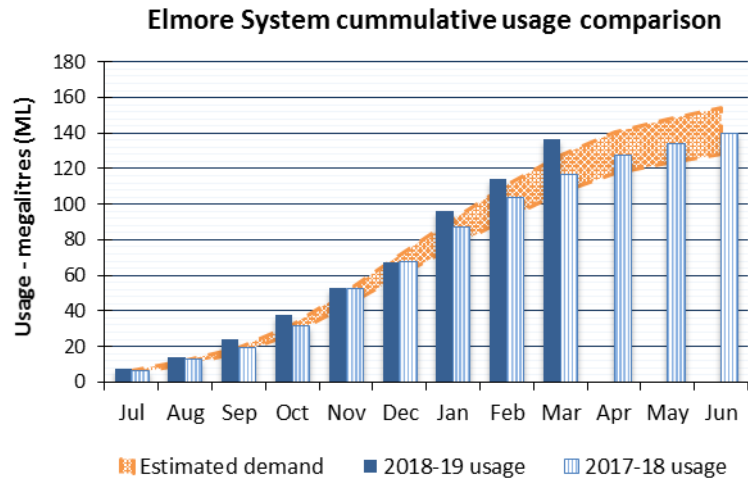

**Monthly usage by town**

The graph below show this month’s water usage for the Elmore System compared with the same period last year.

